

Bellaterra: 31st of May, 2017
File number: 17/14409-898
Client reference: **SOPREMA IBERIA, S.L.U.**
C/ Ferro, 7 – Pol. Ind. Can Pelegrí
08755 Castellbisbal (Barcelona)

TEST REPORT

The present document is a translation of the original test report in Spanish file number **17/14409-898**. In case of dispute, the valid document is the original Spanish version. This translation is issued the 1st of June, 2017

Requested test: Laboratory measurement of airborne sound insulation, in accordance with the standard UNE-EN ISO 10140-2:2011, of a specimen of high-density polymer-based membrane commercial reference **TECSOUND 50**

Date of test: 25th of April, 2017

Test carried out by: Xavier Roviralta (Acoustics Laboratory - LGAI Technological Center)

Xavier Roviralta
Technical Manager of Acoustics
LGA Technological Center S.A.

Service Quality Assurance

Applus+ guarantees that this work has been made in accordance with our Quality and Sustainability System, fulfilling the contractual conditions and legal norms. Within our improvement program we would be grateful if you would send us any commentary that you consider opportune, to the person in charge who signs this document, or to the Quality Manager of Applus+, in the following e-mail address: satisfaccion.cliente@applus.com

The reproduction of this document is only authorized if it is made in its totality. Electronically signed reports in digital format are considered original documents, as well as their electronic copies. Their printing has no legal validity.

This document consists of 12 pages 0 of which are Appendixes.

- Page 1 -

1.- SCOPE OF THE TEST

Laboratory measurement of airborne sound insulation, in accordance with the standard UNE-EN ISO 10140-2:2011, of a specimen of high-density polymer-based membrane commercial reference **TECSOUND 50**.

2.- MEASUREMENT EQUIPMENT

The equipment used in the acoustic measurements is the following:

- Spectrum analyser id no.: 170701 (Bruel&Kjaer mod. Pulse LAN-XI)
- Microphone calibrator id no.: 103032 (Bruel&Kjaer mod. 4231)
- Diffuse field microphones id no.: 103128 and 103131 (Bruel&Kjaer mod. 4943)
- Rotating microphone booms id no.: 170691 and 170692 (Ntek mod. MB-01)
- Omnidirectional sound sources id no.: 170260 and 170261 (CESVA mod. BP012)
- Noise generator with power amplifier id no.: 103125 (CESVA mod. AP600)
- Equalizer id no.: 170092 (INTER mod. EQ-9231)
- Thermo-hygrometer and barometer id no.: 170539 (Oregon Scientific mod. WMR88)
- Tape measurer id no.: 103095 (Stanley mod. Powerlock)
- Distance meter id no.: 170136 (Stanley mod. TLM130)


3.- TEST PROCEDURE AND EVALUATION

3.1. TEST METHOD

Test carried out in accordance with the standard UNE-EN ISO 10140-2:2011, "Measurement of airborne sound insulation", which is part 2 of the set of standards UNE-EN ISO 10140 "Laboratory measurement of sound insulation of building elements".

Two horizontally or vertically adjacent rooms are used, one being designated the source room and the other the receiving room. The test element is mounted in an opening in the partition between those rooms. In the source room, a diffuse sound field is generated with a level enough to measure, in the receiving room, a sound pressure level at least 6 dB higher (preferably more than 15 dB) than the background noise level, at any frequency band. If this is not fulfilled, corrections specified in the standard UNE-EN ISO 10140-4:2011 shall be applied.

The average sound pressure levels in the source room and in the receiving room are measured, according to the procedure specified in the standard UNE-EN ISO 10140-4:2011.

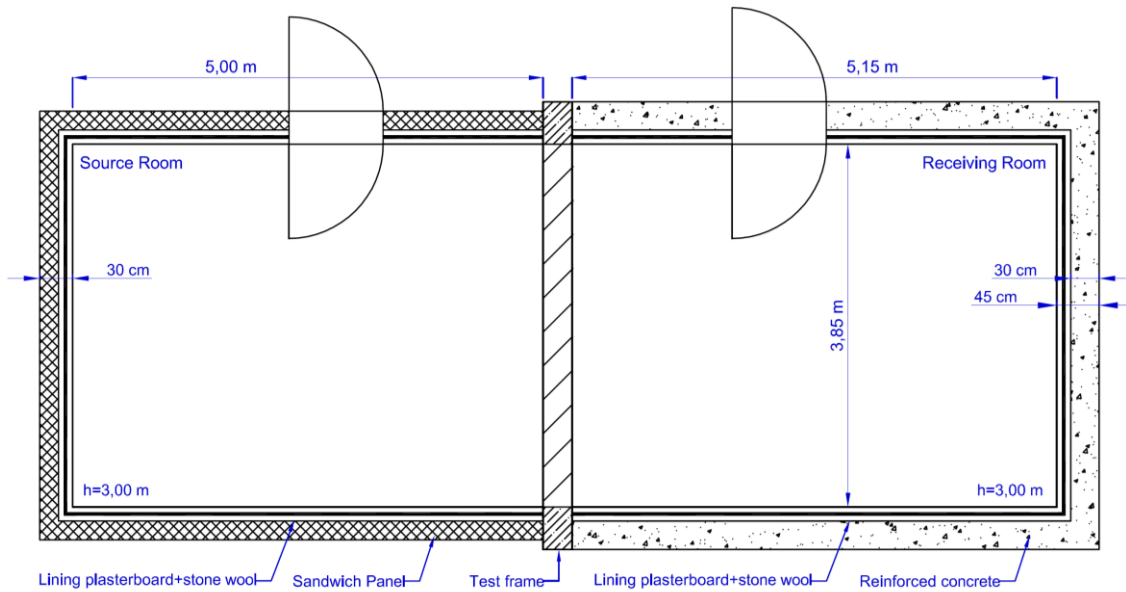

Schematic sketch of the test rooms

The **sound reduction index, R** , is calculated using:

$$R = L_1 - L_2 + 10 \lg \left(\frac{S}{A} \right) \text{ [dB]}$$

where:

- L_1 is the energy average sound pressure level in the source room (dB)
- L_2 is the energy average sound pressure level in the receiving room (dB)
- S is the area of the free test opening in which the test element is installed (m^2)
- A is the equivalent sound absorption area in the receiving room (m^2)

The equivalent absorption area, A , in square meters, from the reverberation time using the Sabine formula is calculated by the following equation:

$$A = \left(\frac{0,16 \cdot V}{T} \right) \text{ [m}^2\text{]}$$

where:

- V is the receiving room volume (m^3)
- T is the receiving room reverberation time (s)

3.2. WEIGHTED SOUND REDUCTION INDEX, R_w

The **weighted sound reduction index**, R_w , is defined in the standard ISO 717-1 as the value, in decibels, of the reference curve (see table 3.1) at the frequency of 500 Hz, after shifting it according to the method laid down in this document.

To evaluate the results of a measurement of R (airborne sound insulation in one-third octave bands), the reference curve is shifted in steps of 1 dB (positive or negative) towards the measured curve until the sum of the unfavourable deviations is as large as possible but no more than 32 dB. Only frequencies within the range of 100 to 3150 Hz are taken into account. An unfavourable deviation at a particular frequency occurs when the result of measurement is less than the reference curve.

Freq. (Hz)	100	125	160	200	250	315
Ref.	33	36	39	42	45	48
Freq. (Hz)	400	500	630	800	1000	1250
Ref.	51	52	53	54	55	56
Freq. (Hz)	1600	2000	2500	3150	4000	5000
Ref.	56	56	56	56	-	-

Table 3.1. Values of the reference curve

3.3. ADAPTATION TERMS (C ; C_{tr})

As defined in the standard ISO 717-1, the adaptation term is the value, in decibels, that can be added to the global rating (R_w, \dots) to take into account the features of peculiar spectrums.

These terms are introduced by the standard to take into account the different spectrums of noise sources (such as pink noise and traffic noise) and to evaluate sound insulation curves with excessive low values in a single frequency band.

In the next informative table, several cases are presented and which adaptation terms can be used:

Suitable Adaptation Term	Type of noise source
C (Adaptation term for pink noise)	Living Activities (talking, music, radio, TV) Children playing Railway traffic at medium and high speed Highway road traffic (> 80 Km/h) Jet aircraft (short distances) Factory emitting mainly middle and high frequency noise
C _{tr} (Adaptation term for traffic noise)	Urban road traffic Railway traffic at low speed Aircraft (propeller driven) and jet aircraft (large distance) Disco music Factory emitting mainly low frequency noise

Table 3.2. Adaptation terms and its suitable use

3.4. A-WEIGHTED SOUND REDUCTION INDEX CALCULATION, R_A

The **A-weighted sound reduction index, R_A**, of a building element is the global rating, in dBA, of the sound reduction index, R, for an incident A-weighted normalized pink noise. In the Annex A of the *Documento Básico "DB-HR Protección frente al ruido" del Código Técnico de la Edificación*, R_A is defined by the following formula from the values of sound reduction index R obtained by laboratory testing:

$$R_A = -10 \log \sum_{i=1}^n 10^{(L_{A,r,i} - R_i)/10} \text{ [dBA]}$$

where:

- R_i is the sound reduction index in the i frequency band, in dB.
- L_{A,r,i} is the value of A-weighted pink noise spectrum in the i frequency band, in dBA.
- i covers all the one-third octave frequency bands from 100 Hz to 5 kHz.

Frec. (Hz)	100	125	160	200	250	315
$L_{A_{r,i}}$	-30,1	-27,1	-24,4	-21,9	-19,6	-17,6
Frec. (Hz)	400	500	630	800	1000	1250
$L_{A_{r,i}}$	-15,8	-14,2	-12,9	-11,8	-11,0	-10,4
Frec. (Hz)	1600	2000	2500	3150	4000	5000
$L_{A_{r,i}}$	-10,0	-9,8	-9,7	-9,8	-10,0	-10,5

Table 3.3: A-weighted normalized pink noise spectrum


3.5 UNCERTAINTY OF RESULTS

The uncertainty associated to the test has been calculated and is available to the petitioner.

4.- TEST ELEMENT DESCRIPTION

The main characteristics of the test element are provided by the test petitioner and listed below (references are specified by the test petitioner).

Manufacturer	SOPREMA IBERIA, S.L.U.
Model / Reference	<i>TECSOUND 50</i>
Supplied by	SOPREMA IBERIA, S.L.U.
Date of reception	30 th of March, 2017
Type of specimen	Membrane
Area, <i>S</i>, of test element (test opening)	1,77 m ² – 1180 x 1500 mm (width x height)
Thickness of test element	2,5 mm
Mass per unit area, <i>m</i>	5 kg/m ²
Composition	High-density polymer-based membrane, asphalt-free.
Assembly conditions	The membrane is installed into the test opening by means of two wooden frames (34x34 mm battens) (see Figure 1). The membrane is fixed to one of the frames by staples. The union between membrane and wooden frames is sealed with silicone (both faces). The joining perimeter between wooden frames and the test opening is sealed with silicone in the receiving room side and with Perennator TX-2001 S putty in the source room side
Sectional drawing	See Figure 1
Test arrangement	According to the specifications in section 6 of the standard EN-ISO 10140-2
Type of assembly	Assembly carried out in a test opening on a high sound insulation filler wall. Filler wall built on a reinforced concrete frame (test frame), placed in the opening between the test rooms
Test element assembly (carried out by/date)	Applus Laboratories – LGAI Technological Center / 24 th and 25 th of April, 2017

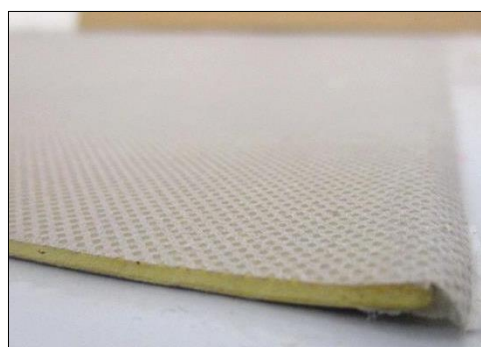


Images 1 to 3 Test element: **TECSOUND 50** membrane



Images 4 to 6 Test element assembly: membrane with wooden frame and perimeter sealing



Images 7 and 8 Test element installed into the test opening: view from the source and receiving room

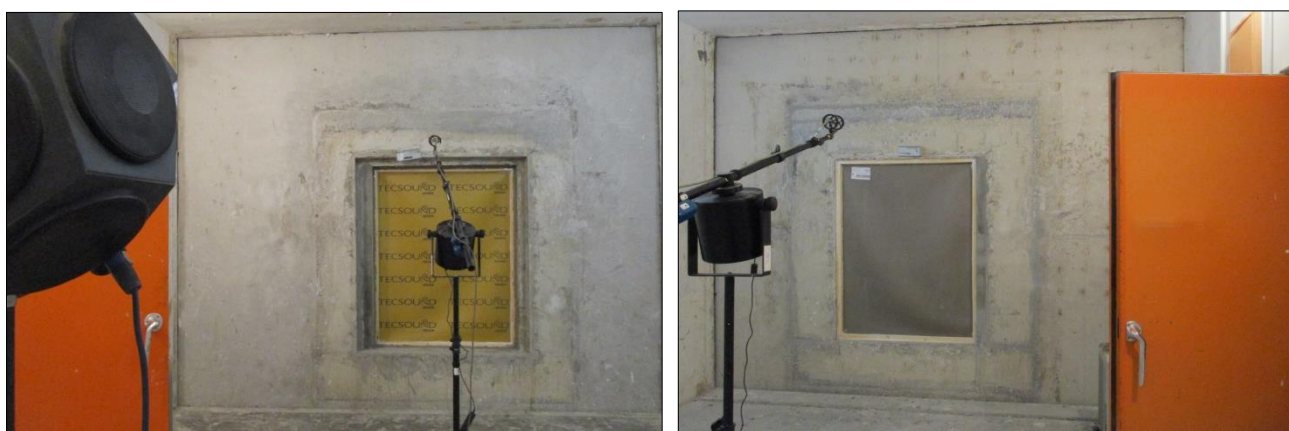

Images 9 and 10 Test element ready to be tested: source room and receiving room, respectively

The following figure shows a sectional drawing of the test element.

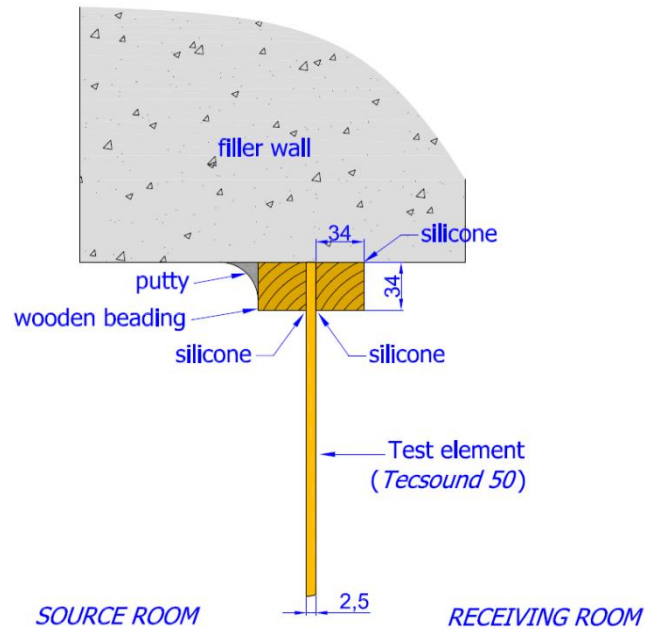


Figure 1 Sectional drawing of the test element (dimensions are mm)

5.- TEST ENVIRONMENT

	Source Room	Receiving Room
Volume	58,2 m ³	59,6 m ³
Environmental conditions	Temperature: 20,4 ±0,8 °C	Temperature: 20,7 ±0,8 °C
	Humidity: 51 ±6 %	Humidity: 50 ±6 %
	Static pressure: 989 ±9 hPa	

6.- RESULTS



Sound reduction index, R , in accordance with ISO 10140-2

Client: SOPREMA IBERIA, S.L.U.

Test element:

Specimen of high-density polymer-based membrane commercial reference **TECSOUND 50**

Mass per unit area, m : 5 kg/m²


Area, S , of test element: 1,77 m² (1180 x 1500 mm)

Date of test: 25th of April, 2017



Frequency (Hz)	R (dB)
(*) 50	16,2
(*) 63	9,5
(*) 80	15,5
100	11,9
125	15,0
160	16,0
200	16,1
250	16,8
315	17,6
400	20,0
500	21,6
630	23,3
800	24,8
1000	26,5
1250	28,2
1600	30,2
2000	31,2
2500	32,9
3150	34,2
4000	36,3
5000	38,8

(*) View **NOTE** on next page

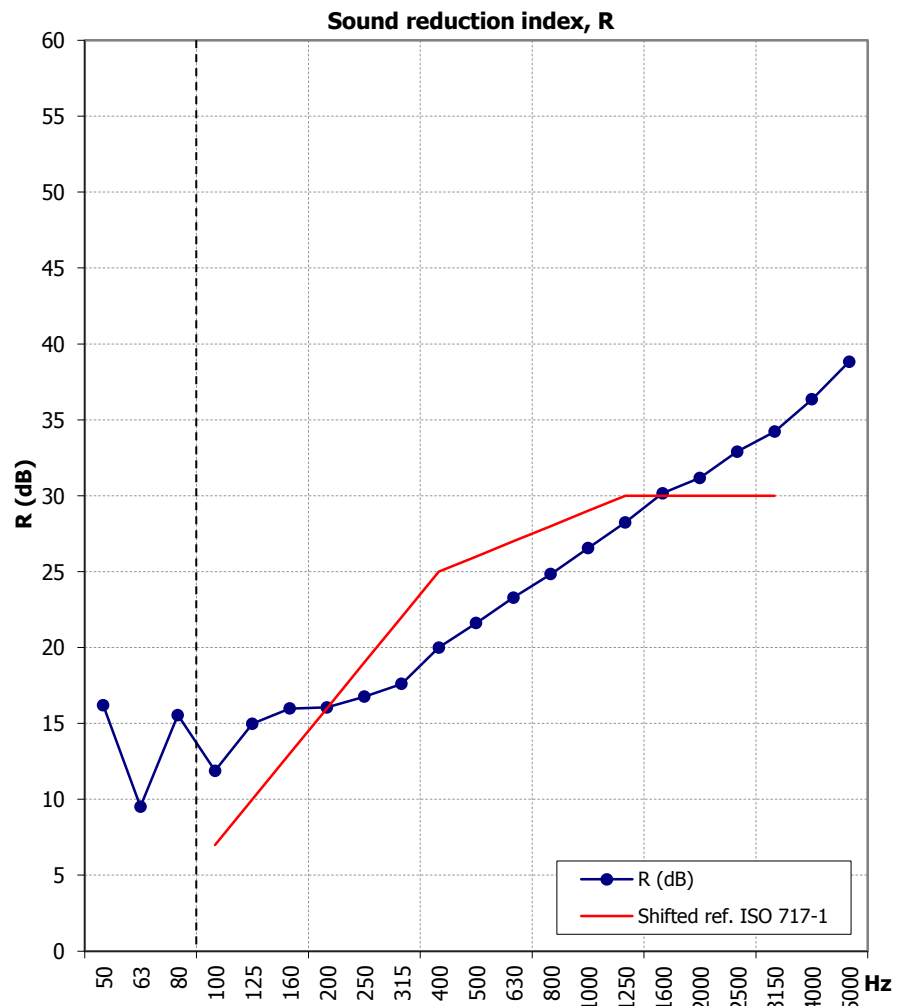

ISO 717-1

Weighted sound reduction index, R_w (C; C_{tr}):

26 (-1; -4) dB

CTE DB-HR

A-weighted sound reduction index, R_A :

26,0 dBA

The results reported in this document relate only to the sample, product or item delivered to LGAI Technological Center the appointed day having been tested under the conditions established in this document.

NOTE:

In the frequency bands of 50, 63 and 80 Hz, indicated with ^(*), the results are outside of our ENAC accreditation schedule. In these bands, the sound field in the test rooms may not be diffuse (especially with the room volumes considered, below 100 m³).

The excitation of the room modes is highly dependent on the source locations. The sound reduction index depends strongly on which room modes are excited. Thus, test results may become dependent on the test facility.

To compensate the lack of diffusivity in the test rooms, at low-frequency measurements the number of loudspeaker positions has been increased to three.